

Technical Information

Liquitrend QMW43

Conductive and capacitive measurement

Continuous measurement of conductivity and thickness of buildup



Application

Developed and built for use in the food and beverages industry.

Meets international hygiene requirements.

Your benefits

- Can be used irrespective of the conductivity of liquid media or pastes
- Flush mount installation, pipes remain piggable
- Easy installation thanks to compact design - even in tight conditions or where access is restricted
- Flexible thanks to two continuous signals, a current output and a frequency output, and digital communication via IO-Link
- Configuration via IO-Link always possible, also if using analog versions (current and frequency outputs)
- Wide range of process connections for installation in new or existing systems
- Robust stainless steel housing, optionally available with IP69 protection

Table of contents

About this document	3	Dimensions	10
Symbols	3	Weight	11
Function and system design	4	Materials	11
Measuring principle	4	Surface roughness	11
Input	4	Human interface	11
Measuring range	4	Operational display (LEDs)	11
Output	4	Operating concept for devices with IO-Link	11
Output signal	4	System integration	12
Signal on alarm	4	Certificates and approvals	12
Signal range	4	CE mark	12
Load	5	RCM-Tick marking	12
Power supply	5	Sanitary compatibility	12
Device plugs	5	CRN approval	13
Supply voltage	5	Test reports	13
Power consumption	5	Pressure equipment with allowable pressure	
Electrical connection	5	≤ 200 bar (2 900 psi)	13
Overvoltage protection	6	Additional certification	13
Performance characteristics	6	RoHS	13
Reference operating conditions	6	Ordering information	13
Maximum measured error under reference conditions	6	Accessories	13
Typical measured error	6	Hexagon tubular socket wrench 32 mm	14
Non-repeatability	7	Plug-in jack, elbowed 90°	14
Switch-on time	7	Plug-in jack, straight	14
Response time	7	Process adapter M24 thread	15
Installation	7	Weld-in adapter	15
Mounting location	7	Grooved union nut DIN11851	15
Vessel or tank	8	Supplementary documentation	16
Pipes	8	Special Documentation	16
Length of connecting cable	8	Supplementary device-dependent documentation	16
Special mounting instructions	8	Registered trademarks	16
Environment	9		
Ambient temperature range	9		
Storage temperature	9		
Humidity	9		
Operating altitude	9		
Pollution degree	9		
Climate class	9		
Degree of protection	9		
Vibration resistance	9		
Shock resistance	9		
Cleaning	9		
Electromagnetic compatibility	9		
Process	9		
Process temperature range	9		
Process pressure range	9		
Mechanical construction	10		
Design	10		

About this document

Symbols

Safety symbols



This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.



This symbol contains information on procedures and other facts which do not result in personal injury.

Symbols for certain types of information and graphics



Permitted

Procedures, processes or actions that are permitted



Preferred

Procedures, processes or actions that are preferred



Forbidden

Procedures, processes or actions that are forbidden



Tip

Indicates additional information



Notice or individual step to be observed

1, 2, 3, ...

Item numbers

A, B, C, ...

Views



Reference to documentation

Function and system design

Measuring principle

A low, galvanically isolated AC voltage is applied at the electrodes in contact with the process. If liquid media or pastes come into contact with the electrode, a measurable current flows. In this way, the device determines the conductivity and the dielectric constant (ϵ_r) of the medium.

The thickness of the buildup is calculated from the ratio between the measuring signals of the two electrodes.

Input

Measured process variable

Electrical conductivity, dielectric constant (ϵ_r) of the medium

Calculated process variable

Thickness of buildup

Measuring range

Conductivity

0 $\mu\text{S}/\text{cm}$ to 100 mS/cm

Minimum permitted span: 3 000 $\mu\text{S}/\text{cm}$ can be ordered; 1 000 $\mu\text{S}/\text{cm}$ can be configured at the device via the IO-Link interface

Thickness of buildup

0 to 10 mm

Output

Output signal

The following options can be selected in the Product Configurator, order code for "Output":

Preconfigured assignment of the outputs:

- Option B
 - OU1: frequency (buildup)
 - OU2: frequency (conductivity)
- Option C
 - OU1: frequency (buildup)
 - OU2: 4 to 20 mA (conductivity)

Select the HT option if the device is to be adjusted to non-conductive media and the measuring range is to be preconfigured.

Variable assignment of the outputs with the conductivity and thickness of buildup parameters:

- Option 7
 - OU1: IO-Link
 - OU2: 4 to 20 mA (off, conductivity or buildup depending on the order, select the HT option)
- Option 8
 - OU1: IO-Link
 - OU2: frequency (off or conductivity depending on the order, select the HT option)

Signal on alarm

The behavior of the output in the event of a failure is regulated in accordance with NAMUR NE43.

Frequency

$f < 260 \text{ Hz}$


Current

$I < 3.6 \text{ mA}$ (as per NAMUR NE43)

- Failure current is output and "S803" displayed (output: MIN alarm current)
- Periodic checking to establish if it is possible to quit fault state


Signal range

- Frequency, lower range value: 300 Hz
- Frequency, end: 3 000 Hz
- Signal range: 270 to 3 100 Hz
- Current: 3.8 to 20.5 mA

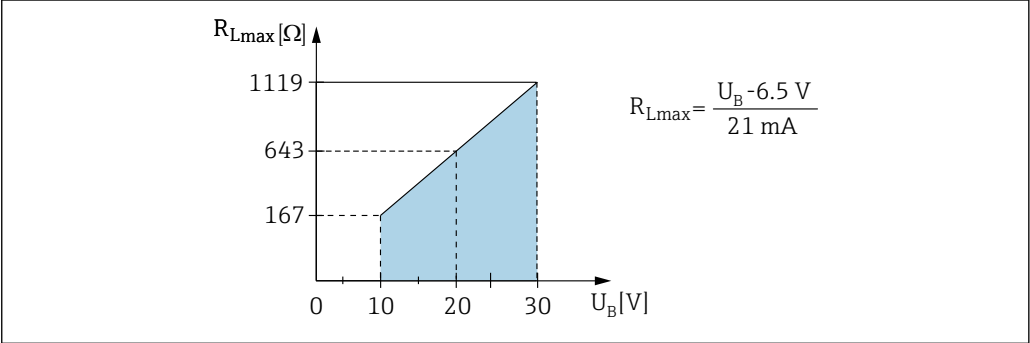Load	Load for 4 to 20 mA output Depends on the supply voltage U_B of the power supply unit: do not exceed the maximum load resistance R_L (including supply line resistance) as otherwise it will not be possible to set the corresponding current.  $R_{Lmax} = \frac{U_B - 6.5 \text{ V}}{21 \text{ mA}}$  1 Load for 4 to 20 mA output
------	---

Power supply

Device plugs	M12 plug: IEC 60947-5-2
Supply voltage	Without digital communication 10 to 30 VDC IO-Link mode 18 to 30 VDC IO-Link communication is guaranteed only if the supply voltage is at least 18 V.
Power consumption	< 1.4 W
Electrical connection	Connecting the device  WARNING Risk of injury from the uncontrolled activation of processes! ▶ Switch off the supply voltage before connecting the device. ▶ Make sure that downstream processes are not started unintentionally.  WARNING Electrical safety is compromised by an incorrect connection! ▶ In accordance with IEC/EN61010 a suitable circuit breaker must be provided for the device . ▶ Voltage source: Non-hazardous contact voltage or Class 2 circuit (North America). ▶ The device must be operated with a fine-wire fuse 500 mA (slow-blow). Protective circuits against reverse polarity are integrated.

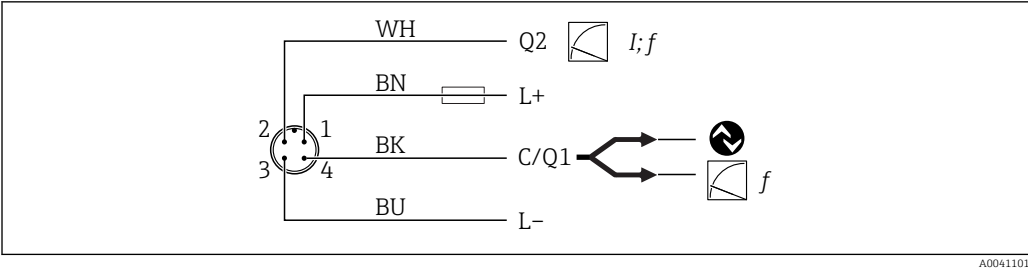

2 Connection

- Pin 1 Supply voltage +
Pin 2 Current output 4 to 20 mA or frequency 300 to 3 000 Hz
Pin 3 Supply voltage -
Pin 4 IO-Link communication or frequency 300 to 3 000 Hz

Post-connection check

- ☐ Are the device and cable undamaged (visual inspection)?
- ☐ Does the supply voltage match the specifications on the nameplate?
- ☐ If supply voltage is present, is the green LED lit?
- ☐ With IO-Link communication: is the green LED flashing?


Overvoltage protection	Overvoltage category II
Reverse polarity protection	Integrated; no damage in the event of reverse polarity or short-circuit
Short-circuit protection	The device is protected against overload and short-circuiting. Intelligent monitoring: Check for overload in intervals of ~ 1.5 s; normal operation is resumed once the overload/short-circuit is fixed.

Performance characteristics

Reference operating conditions	- Ambient temperature: constant 20 °C (68 °F) ±5 °C (9 °F) - Medium: water, conductivity approx. 200 µS/cm - Medium temperature: 20 °C (68 °F) ±5 °C (9 °F) - Conductivity: fully covered, sensor covered by 20 mm of medium - Coverage: up to max. 6 mm
Maximum measured error under reference conditions	Conductivity ≤ 5 %
Typical measured error	Conductivity 0 to 2 mS/cm: ≤ 5 % of reading ± 0.2 µS/cm 2 to 20 mS/cm: ≤ 7 % of reading 20 to 50 mS/cm: ≤ 10 % of reading 50 to 100 mS/cm: ≤ 15 % of reading The sensor must be covered by at least 20 mm of medium. The data indicated are typical measured errors. In individual cases, the effects of factors such as polarization can result in different values.

Buildup

 The typical measured error is between the limits indicated.

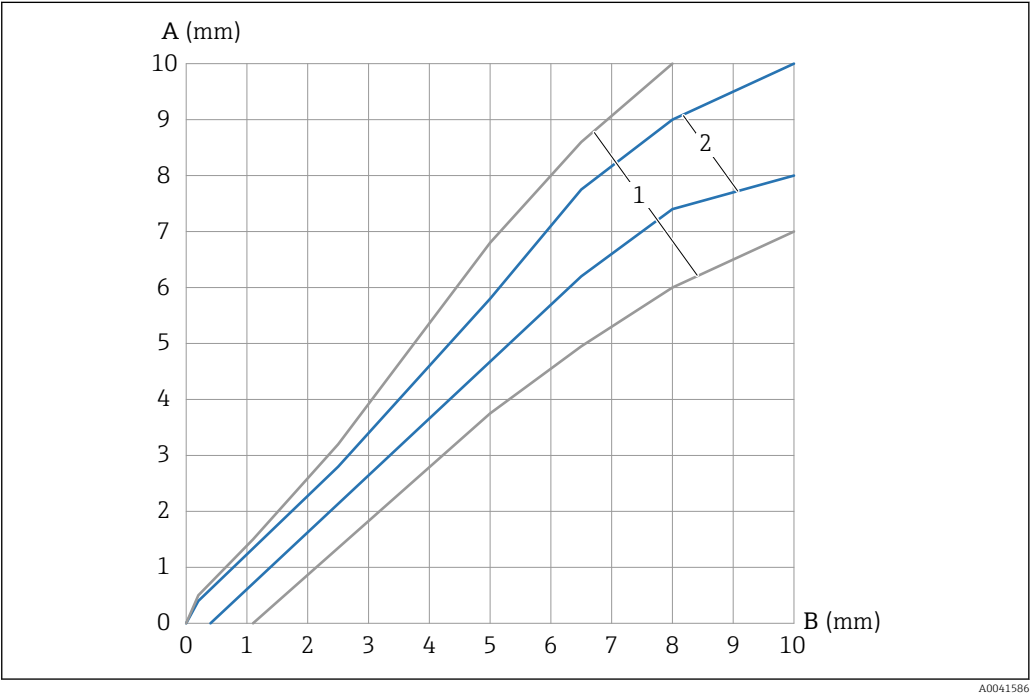

 3 Buildup measured error

- A Buildup measured value
- B Actual buildup
- 1 0 to 100 mS/cm
- 2 0.01 to 20 mS/cm

Non-repeatability

Conductivity
0 to 2 mS/cm: $\leq 0.5\%$ of reading $\pm 0.2\ \mu\text{S/cm}$
2 to 20 mS/cm: $\leq 0.75\%$ of reading
20 to 50 mS/cm: $\leq 1.5\%$ of reading
50 to 100 mS/cm: $\leq 2.5\%$ of reading
Buildup
 $\leq 0.25\ \text{mm}$

Switch-on time

$< 2\ \text{s}$

Response time


Configurable damping
0.1 to 60 s
T63: as per set damping. Output has behavior of PT₁ element.
Dead time
250 ms

Installation

Mounting location

Installation in vessel, pipe or tank.


Vessel or tank

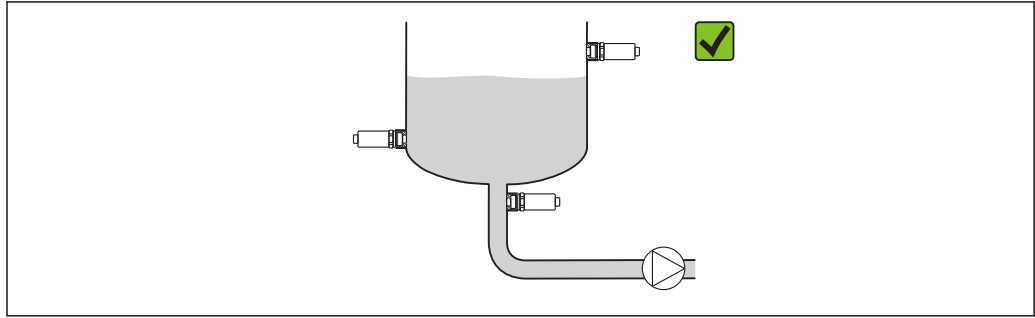

A0040922


4 Installation examples

Pipes

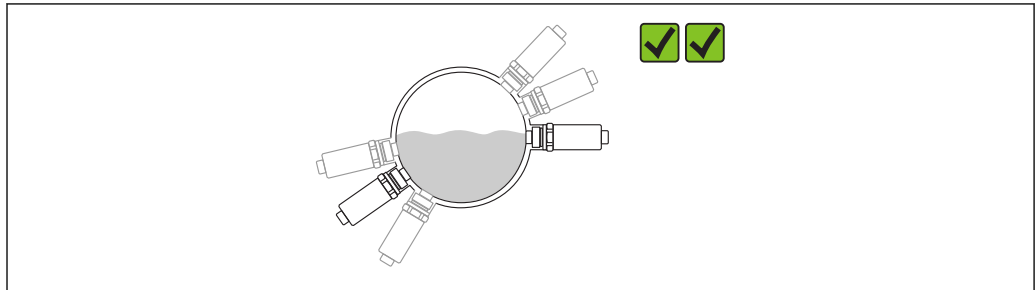

A0021052


5 Horizontal orientation → preferred orientation

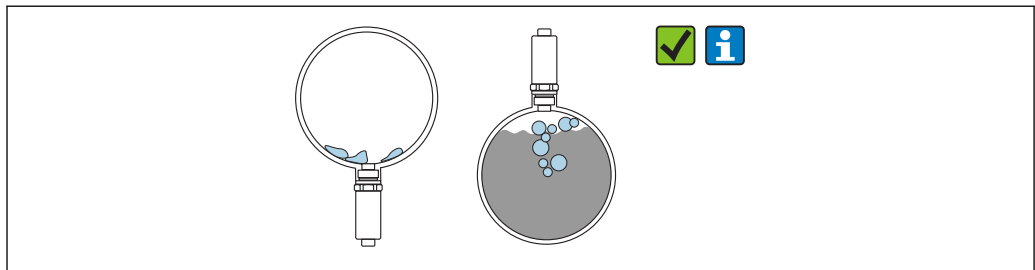

A0038773

6 Vertical orientation → formation of buildup or bubbles on the sensor must be taken into account

i The possibility of buildup or bubbles forming on the sensor when installed vertically must be taken into account. If the sensor is partially covered, or if encrustations or air bubbles have formed on the sensor, this will be reflected in the measured value.

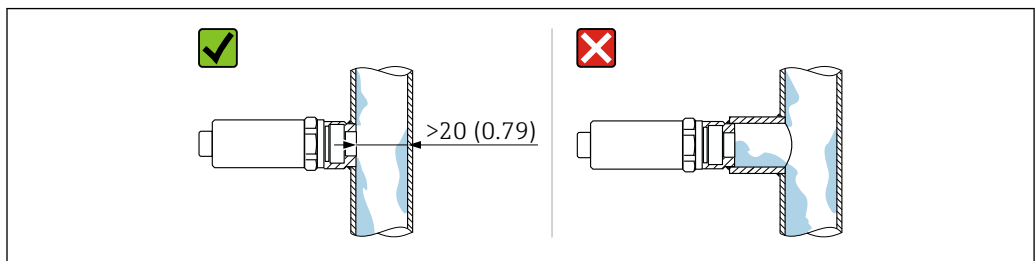

A0041584

7 Flush-mounted orientation. Unit of measurement mm (in)

Length of connecting cable

- Max. 25 Ω /core, total capacity < 100 nF
- IO-Link communication: < 10 nF

Special mounting instructions

- When installing the plug, do not allow moisture to enter the plug or socket area
- Protect housing against impact

Environment


Ambient temperature range	At the housing: -40 to +70 °C (-40 to +158 °F)
Storage temperature	-40 to +85 °C (-40 to +185 °F)
Humidity	Operation up to 100 %. Do not connect in a condensing atmosphere.
Operating altitude	Up to 2 000 m (6 600 ft) above sea level
Pollution degree	Pollution degree 4
Climate class	DIN EN 60068-2-38/IEC 68-2-38: Test Z/AD
Degree of protection	■ IP65/67 NEMA type 4X enclosure (plastic housing cover) ■ IP66/68/69 NEMA type 4X/6P enclosure (metal housing cover)
Vibration resistance	As per test Fh, EN 60068-2-64:2008: $a(\text{RMS}) = 50 \text{ m/s}^2$, $f = 5 \text{ to } 2\,000 \text{ Hz}$, $t = 3 \text{ axes} \times 2 \text{ h}$
Shock resistance	As per test Ea, prEN 60068-2-27:2007: $a = 300 \text{ m/s}^2 = 30 \text{ g}$, $3 \text{ axes} \times 2 \text{ directions} \times 3 \text{ shocks} \times 18 \text{ ms}$
Cleaning	Resistant to typical cleaning agents from the outside, in accordance with Ecolab test.
Electromagnetic compatibility	Electromagnetic compatibility in accordance with all the relevant requirements of the EN 61326 series.  Details: Declaration of Conformity Only the requirements of IEC/EN 61131-9 are met if IO-Link communication is used. If the device is installed in plastic structures, its function may be influenced by strong electromagnetic fields. Emission requirements for class A equipment are met (only for use in "industrial environments").

Process

Process temperature range	-20 to +100 °C (-4 to +212 °F) ■ For 1 h: +150 °C (+302 °F) ■ M24 process adapter with EPDM process seal for 1 h: +130 °C (+266 °F)
Process pressure range	-1 to +25 bar (-14.5 to +362.5 psi)

Mechanical construction


Design

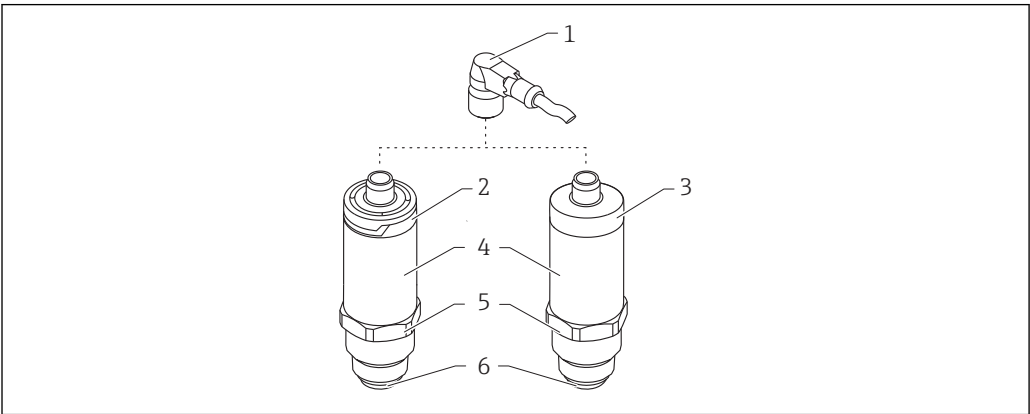

A0036957

-  8 *Product design*
- 1 *M12 plug*
 - 2 *Plastic housing cover IP65/67*
 - 3 *Metal housing cover IP66/68/69*
 - 4 *Housing*
 - 5 *Process connection*
 - 6 *Sensor*

Dimensions

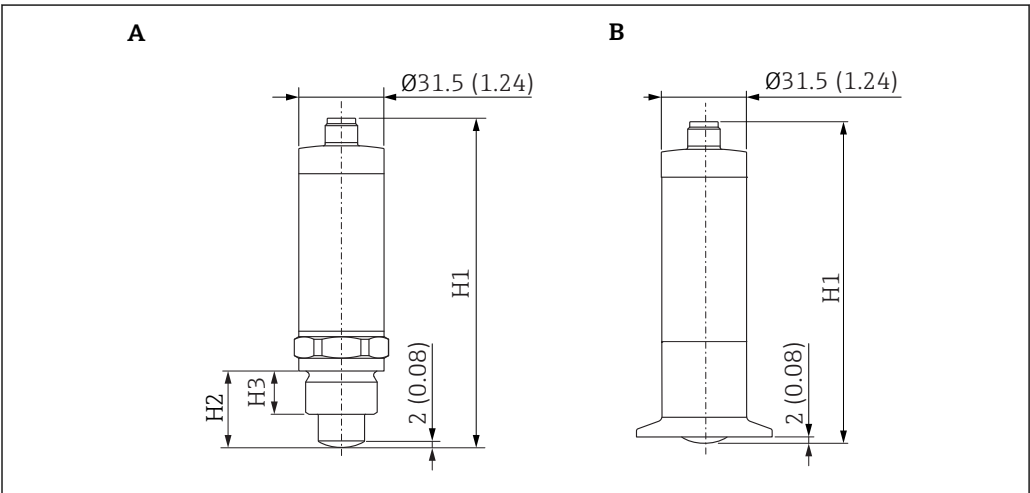

A0040941

- Unit of measurement mm (in)*
- A *Device with threaded connection*
 - B *Device with clamp/DIN11851 process connection*

Process connections

A: Device with threaded connection; product structure: order code for "Process connection", options W5J, WSJ, X2J; material: 316L, dimensions in: mm (in)

A	G 3/4", W5J	G 1", WSJ	M24 1.5, X2J
H1	122 (4.8)	124 (4.88)	122 (4.8)
H2	28 (1.1)	32 (1.26)	19 (0.75)
H3	16 (0.63)	19 (0.75)	13 (0.51)

B: Device with clamp/DIN11851 process connection; product structure: order code for "Process connection", options 3CJ, 3EJ, 1AJ, 1CJ; material: 316L; dimensions in: mm (in)


B	Tri-Clamp ISO2852		DIN11851	
	DN25-38 (1...1-1/2"), 3CJ	DN40-51 (2"), 3EJ	DN25 PN40, 1AJ	DN25 PN40, 1CJ
H1	117 (4.61)	117 (4.61)	117 (4.61)	117 (4.61)

Weight	Approx. 300 g (10.58 oz)
---------------	--------------------------

Materials	Sensor: 316L (1.4404), PEEK (The material PEEK meets the requirements of EU 1935/2004, 10/2011, 2023/2006 and FDA 21 CFR 177.1380)
	Process connection: 316L (1.4404/1.4435)
	M12 connector: Housing cover (depending on the design): ■ PPSU ■ 316L (1.4404/1.4435)
	Design ring: PBT/PC
	Housing: 316L (1.4404/1.4435)
	Nameplate: Lasered onto housing

Surface roughness	Wetted sensor surface: $R_a \leq 0.76 \mu\text{m}$ (30 μin)
-------------------	---

Human interface

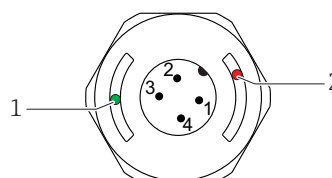Operational display (LEDs)

A0041152

9 Position of LEDs in housing cover

- 1 Green (GN), communication status
2 Red (RD), warning/maintenance required

 There is no external signaling via LEDs on the metal housing cover (IP69).

Operating concept for devices with IO-Link

Operator-oriented menu structure for user-specific tasks

Quick and safe commissioning

Guided menus for applications

Reliable operation

Operation in the following languages:
Via IO-Link: English

Efficient diagnostic behavior increases measurement availability

- Remedial measures
- Simulation options

System integration**IO-Link information**

IO-Link is a point-to-point connection for communication between the device and an IO-Link master. This requires an IO-Link compatible module (IO-Link master) for operation. The IO-Link communication interface enables direct access to the process and diagnostic data. It also provides the option of configuring the device during operation.

The device supports the following characteristics of the physical layer:

- IO-Link specification: version 1.1
- IO-Link Smart Sensor Profile 2nd Edition
- SIO mode: Yes
- Speed: COM2; 38.4 kBaud
- Minimum cycle time: 6 ms
- Process data width: 32 bit
- IO-Link data storage: Yes
- Block configuration: Yes



Regardless of the customer-specific default settings selected, the device always has the option of communicating or being configured via IO-Link.

IO-Link download

<http://www.endress.com/download>

- Select "Device Driver" from the list displayed
- In the Type search field, select "IO Device Description (IODD)"
- In the Product Code search field, select the product root
- Click "Search" button → Select result → Download

Optional: In the Text Search search field, enter the device name.

Certificates and approvals

Currently available certificates and approvals can be called up via the product configurator.

CE mark

The measuring system meets the legal requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity along with the standards applied.

Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.

RCM-Tick marking

The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products are labelled with the RCM- Tick marking on the name plate.



A0029561

Sanitary compatibility

The device has been developed for use in hygienic processes. The materials in contact with the process meet FDA requirements as well as the 3-A Sanitary Standard No. 74-xx. Endress+Hauser confirms this by affixing the 3-A symbol to the device. As an option, a certificate of conformity according to EC/1935/2004 can be ordered.

The following certificate copies can be ordered with the device (optional):

3-A



EHEDG



- If cleaning in place (CIP) is required, process adapters that comply with 3-A requirements are available. If installed horizontally, ensure that the leakage hole is pointing down. This allows leaks to be detected as quickly as possible.
- To avoid the risk of contamination, install the device according to the EHEDG design principles outlined in document 8 "Hygienic Equipment Design Criteria".
- Suitable connections and seals must be used in order to guarantee a hygienic design according to the latest design version.
Hygienic design according to 3-A specifications and the EHEDG "Position Paper".
- For information on 3-A and EHEDG-approved weld-in adapters, see Technical Information TI00426F.
- Gap-free connections can be cleaned of all residue using sterilization in place (SIP) and cleaning in place (CIP), which are industry-standard cleaning methods. Attention must be paid to the pressure and temperature specifications of the sensor and process connections for CIP and SIP processes.

CRN approval

Versions with a CRN approval (Canadian Registration Number) are listed in the corresponding registration documents. CRN-approved devices are marked with a registration number.

Any restrictions regarding the maximum process pressure values are listed on the CRN certificate.

Test reports

The following documents can be ordered with the device (optional):

- Certificate of conformity EC 1935/2004
- Acceptance test certificate as per EN 10204-3.1
- Test report of surface roughness ISO4287/Ra

Pressure equipment with allowable pressure ≤ 200 bar (2 900 psi)

Pressure instruments with a flange and threaded boss that do not have a pressurized housing do not fall within the scope of the Pressure Equipment Directive, irrespective of the maximum allowable pressure.

Reasons:

According to Article 2, point 5 of EU Directive 2014/68/EU, pressure accessories are defined as "devices with an operational function and having pressure-bearing housings".

If a pressure instrument does not have a pressure-bearing housing (no identifiable pressure chamber of its own), there is no pressure accessory present within the meaning of the Directive.

Additional certification

CSA C/US General Purpose

RoHS

The measuring system complies with the substance restrictions of the Restriction on Hazardous Substances Directive 2011/65/EU (RoHS 2).

Ordering information


Detailed ordering information is available from your nearest sales organization
www.addresses.endress.com.

Accessories



Accessories can be ordered with the device (optional) or separately.

Hexagon tubular socket wrench 32 mm

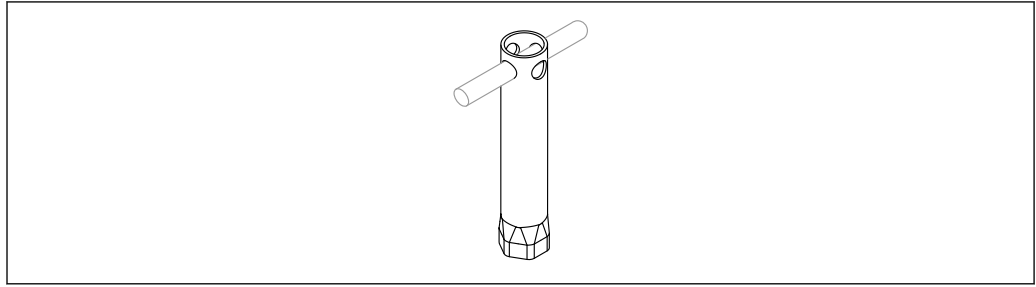


A0038864

10 Hexagon tubular socket wrench

Order number: 52010156

i To mount the device in locations that are difficult to access.

Plug-in jack, elbowed 90°

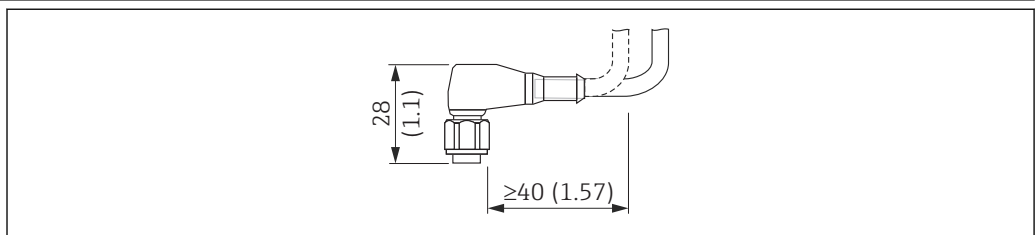

A0024477

11 Example of plug-in jack M12. Unit of measurement mm (in)

Plug-in jack M12 IP69

- Terminated connector
- 5 m (16 ft) PVC cable (orange)
- Body: PVC (orange)
- Slotted nut 316L (1.4435)
- Order number: 52024216


Plug-in jack M12 IP67

- Terminated connector
- 5 m (16 ft) PVC cable (gray)
- Body: PUR (blue)
- Slotted nut Cu Sn/Ni
- Order number: 52010285

i Core colors for M12 plug:

- 1 = BN (brown)
- 2 = WH (white)
- 3 = BU (blue)
- 4 = BK (black)

Plug-in jack, straight

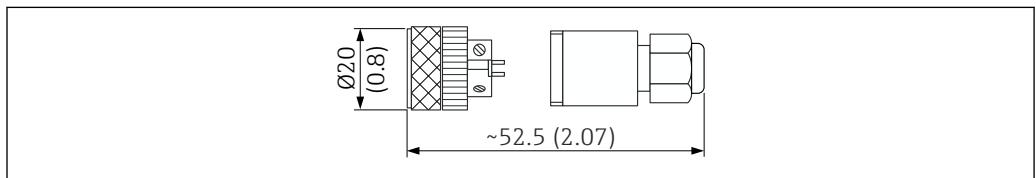

A0022293

12 Dimensions of self-terminated connection. Unit of measurement mm (in)

Plug-in jack M12 IP67

- Straight
- Self-terminated connection to M12 connector
- Body: PBT
- Slotted nut Cu Sn/Ni
- Order number: 52006263

Process adapter M24 thread

Material

For all versions:

- Adapter
316L (1.4435)
- Seal
EPDM

Process adapter M24 PN25

Available versions:


- DIN11851 DN50 with slotted nut
- SMS 1 ½"

Process adapter M24 PN40

Available versions:

- Varivent F
- Varivent N

Weld-in adapter

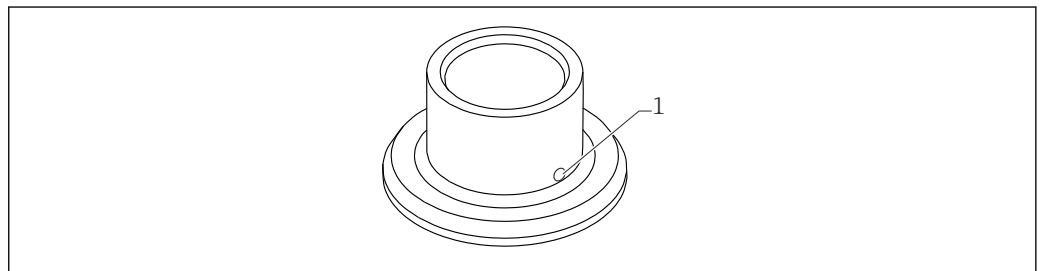

A0023557

13 Sample drawing of weld-in adapter

1 Leakage hole

G ¾"

Available versions:

- ø 50 mm (1.97 in) - Installation on vessel
- ø 29 mm (1.14 in) - Installation in pipe

G 1"

Available versions:


- ø 53 mm (2.09 in) - Installation on vessel
- ø 60 mm (2.36 in) - Installation on pipe

M24

Available versions:

- ø 65 mm (2.56 in) - Installation on vessel

Grooved union nut DIN11851

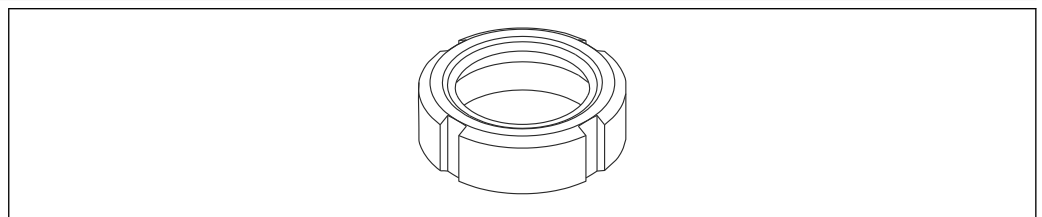

A0023556

14 Sample drawing of grooved union nut

Material

For all versions:

304 (1.4307)

For milk pipe DIN11851

Available versions:

- DN25 - F26
- DN40 - F40
- DN50 - F50

Supplementary documentation



The certificates, approvals and other documentation currently available can be accessed as follows:

Endress+Hauser website: www.endress.com → Downloads.

Special Documentation

- TI00426F: Adapter and flanges (overview)
- SD01622P: Weld-in adapter (installation instructions)

Supplementary device-dependent documentation

Document type: Operating Instructions (BA)

Installation and initial commissioning – contains all functions in the operating menu that are required for a typical measuring task. Functions beyond this scope are not included.
BA01925F

Document type: Brief Operating Instructions (KA)

Quick guide to the first measured value – includes all essential information from the incoming acceptance to the electrical connection.
KA01448F

Registered trademarks



IO-Link

is a registered trademark of the IO-Link company group.

中国E+H技术销售 www.ainstru.com

电话: 18923830905

邮箱: sales@ainstru.com